


Mounting of filling level probe with screwed protective tube

The probe body contains a SERTO screwing which needs to be connected to a **protective pipe** for the probe wire made of stainless steel or copper!
 The protective pipe prevents the probe wire from making contact with the liquid (medium).
 The protective pipe needs to have an outer diameter of at least $d=12\text{mm}$. It is not included in the delivery contents.
 When using a protective pipe the enclosed supporting sleeve has to be inserted into the copper pipe closure!


If the probe wire is permanently in touch with an aggressive medium like fuel, acid, etc. **no warranty** regarding the probe's durability can be granted!

Protective cap:

Probes with a yellow protective cap need to have the cap removed before lowering the probe into the tank!

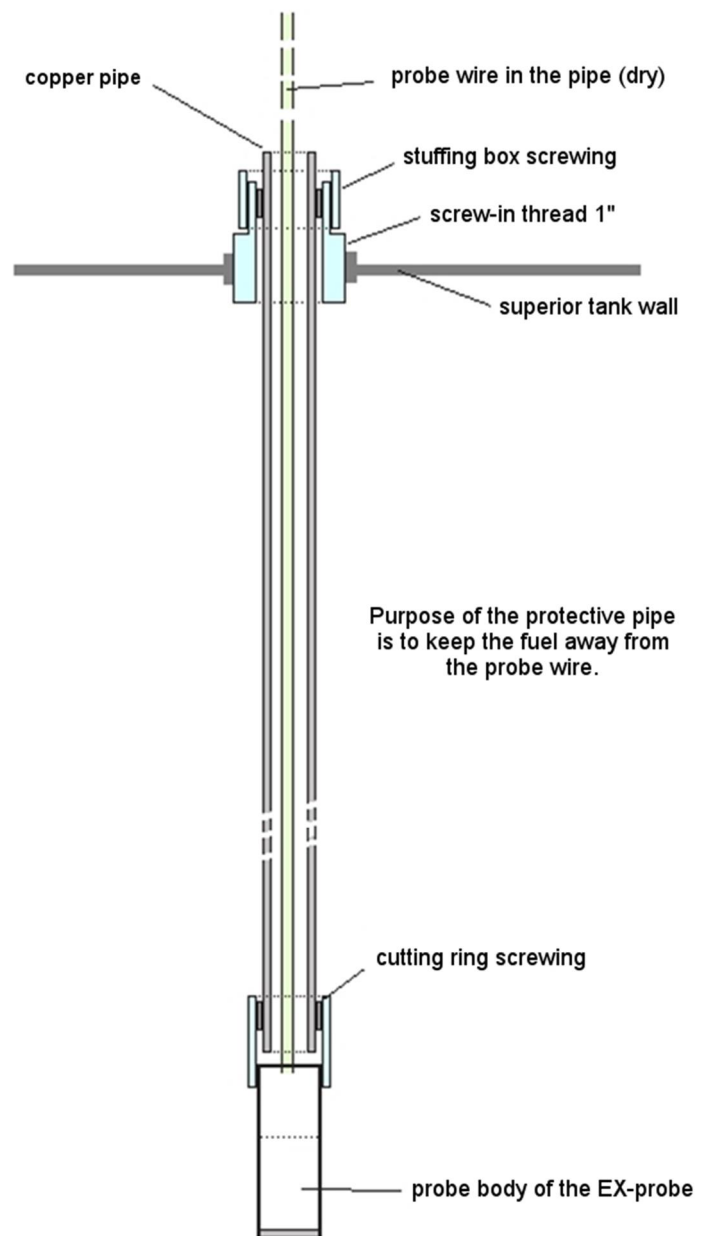

Probe mounting for external tanks

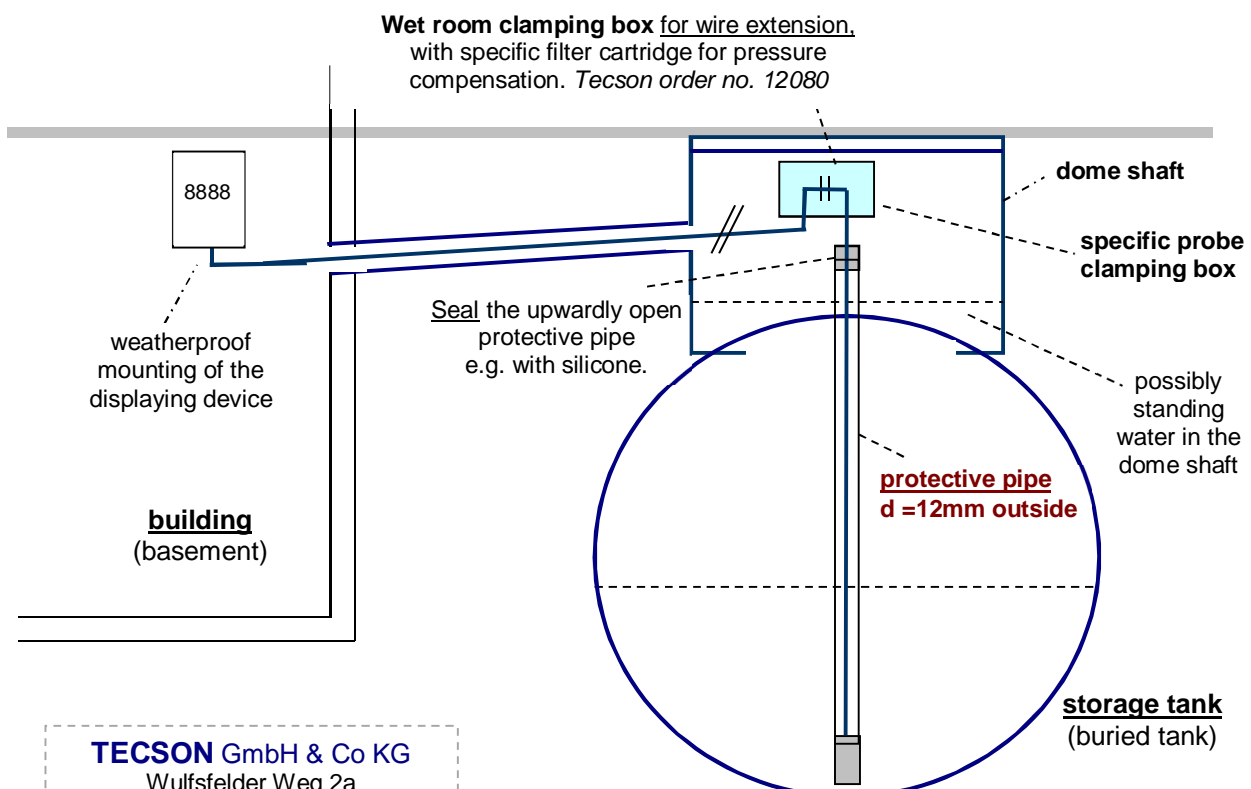

TECSON GmbH & Co KG
 Wulfsfelder Weg 2a
 D-24242 Felde
www.tecson.de